

# DIFFERENTIAL PRESSURE (FLOW) TRANSMITTER


## Hydroseal® Diaphragm Version

**DATA SHEET**
**FKC...4**

### FEATURES

#### 1. Unique hydroseal diaphragm

Permeation of hydrogen into the detecting unit through seal diaphragm can be suppressed thanks to the unique seal diaphragm (double coating) which employs coating of gold and ceramic.

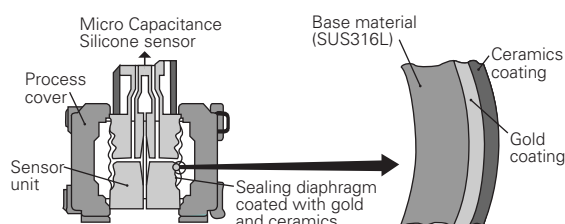

#### 2. High accuracy

±0.15% accuracy for all calibrated spans is the standard feature for differential pressure (flow) transmitter covering 0.32 to 130kPa (or 32mm to 13 mH<sub>2</sub>O). Fuji's Micro-capacitance silicon sensor assures this feature.

#### 3. Minimum environment influence

Fuji's patented "Advanced Floating Cell" design which protects the pressure sensor against changes in temperature, static pressure, and overpressure substantially reduces total measurement error in actual field applications.

#### 4. Fuji/HART® bilingual communications protocol and FOUNDATION™ fieldbus and Profibus™ compatibility

FCX-AII series transmitter offers bilingual communications to speak both Fuji proprietary protocol and HART®. Any HART® compatible devices can communicate with FCX-AII. Further, by upgrading electronics FOUNDATION™ fieldbus and Profibus™ are also available.

#### 5. Application flexibility

Various options that render the FCX-AII series suitable for almost any process applications include.

- Analog indicator at either the electronics side or terminal side
- Full range of hazardous location approvals
- 5-digit LCD meter with engineering unit
- Stainless steel electronics housing
- Built-in RFI filter and lightning arrester

#### 6. Programmable output Linearization Function

In addition to Linear and Square Root, output signal can be freely programmable.

(Up to 14 compensated points at approximation.)

#### 7. Burnout current flexibility (Under Scale: 3.2 to 3.8mA, Over Scale: 20.8 to 21.6mA)

Burnout signal level is adjustable using Model FXW Hand Held Communicator (HHC) to comply with NAMUR NE43.



#### 8. Dry calibration without reference pressure

Thanks to the best combination of unique construction of mechanical parts (Sensor unit) and high performance electronics circuit (Electronics unit), reliability of dry calibration without reference pressure is at equal level as wet calibration.

### SPECIFICATIONS

#### Functional specifications

**Service:** Liquid, gas, or vapour

**Static pressure, span, and range limit:**

Type	Static pressure [MPa] {bar}	Span limit [kPa] {mbar}		Range limit [KPa] {m bar}
		Min.	Max.	
FKC□ 33	–0.1 to 16 (–1 to + 160)	3.2 (32)	32 (320)	+/- 32 (+/- 320)
FKC□ 35	–0.1 to 16 (–1 to + 160)	13 (130)	130 (1300)	+/- 130 (+/-1300)


- Lower limit of static pressure (vacuum limit) ;  
Silicone fill sensor: See Fig. 1  
Fluorinated fill sensor: 66kPa abs (500mmHg abs)  
at temperature below 60°C
- The maximum span of each sensor can be converted to different units using below factors.  
1MPa=10<sup>3</sup>KPa=10bar=10.19716kgf/cm<sup>2</sup>  
=145.0377psi  
1kpa=10mbar=101.9716mmH<sub>2</sub>O=4.01463inH<sub>2</sub>O

**Overrange limit:** To maximum static pressure limit

**Output signal:** 4 to 20mA DC (linear or square root) with digital signal superimposed on the 4 to 20mA signal

**Power supply:** Transmitter operates on 10.5V to 45V DC at transmitter terminals.  
10.5V to 32V DC for the units with optional arrester.

Load limitations: see figure below

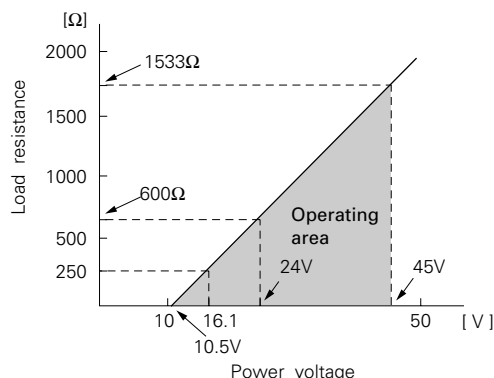

Note: For communication with HHC (Model: FXW), min. of 250  $\Omega$  required.

#### Hazardous locations:

Authorities	Flameproof	Intrinsic safety	Type n Nonincendive
ATEX	Ex II 2 GD - EExd IIC T5/T6	Ex II 1 GD - EExia IIC T4/T5	Ex II 3 GD - EExn IIC T4/T5
Factory Mutual	Class I II III Div. 1 Groups B thru. G	Class I II III Div. 1 Groups A thru. F	Class I II III Div. 2 Groups A thru. G
CSA	Class I II III Div. 1 Groups C thru. G	Class I II III Div. 1 Groups A thru. G	Class I II III Div. 2 Groups A thru. G
TIIS	Ex do IIB+H <sub>2</sub> T4	Ex ia IIC T4 (*)	—

(\*) Approval pending

#### Zero/span adjustment:

Zero and span are adjustable from the HHC<sup>(1)</sup>. Zero and span are also adjustable externally from the adjustment screw (span adjustment is not available with 9th digit code "L, P, M, Q, S, N").

#### Damping:

Adjustable from HHC or local adjustment unit with LCD display.

The time constant is adjustable between 0.12 to 32 seconds.

#### Zero elevation/suppression:

–100% to +100% of URL

#### Normal/reverse action:

Selectable from HHC<sup>(1)</sup>

#### Indication:

Analog indicator or 5-digit LCD meter, as specified.

#### Burnout direction: Selectable from HHC<sup>(1)</sup>

If self-diagnostic detect transmitter failure, the analog signal will be driven to either "Output Hold", "Output Overscale" or "Output Underscale" modes.

##### "Output Hold":


Output signal is hold as the value just before failure happens.

##### "Output Overscale":

Adjustable within the range 20.8mA to 21.6mA from HHC<sup>(1)</sup>

##### "Output Underscale":

Adjustable within the range 3.2mA to 3.8mA from HHC<sup>(1)</sup>

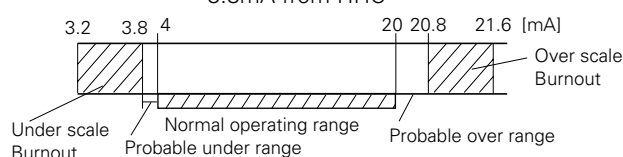

#### Loop-check output:

Transmitter can be configured to provide constant signal 3.8mA through 21.6mA by HHC<sup>(1)</sup>.

#### Temperature limit:

Ambient: –40 to +85°C

(–20 to +80°C for LCD indicator)

(–40 to +60°C for arrester option)

(–10 to +60°C for fluorinated oil filled transmitters)

For explosionproof units (flameproof or intrinsic safety), ambient temperature must be within the limits specified in each standard.

Process: –40 to +120°C for silicone fill sensor

–20 to +80°C for fluorinated oil fill sensor

Storage: –40 to +90°C

0 to 100% RH

#### Humidity limit:

Communication: With HHC<sup>(1)</sup> (Model FXW, consult Data Sheet No. EDS8-47), following information can be remotely displayed or reconfigured.

Note: HHC's version must be more than 6.0 (or FXW □□□□1–□3), for FCX-A II.

Items	Display	Set
Tag No.	✓	✓
Model No.	✓	✓
Serial No.	✓	—
Engineering unit	✓	✓
Range limit	✓	—
Measuring range	✓	✓
Damping	✓	✓
Output mode	Linear	✓
	Square root	✓
Burnout direction	✓	✓
Calibration	✓	✓
Output adjust	—	✓
Data	✓	—
Self diagnoses	✓	—
Printer	—	—
External switch lock	✓	✓
Transmitter display	✓	✓
Linearize	✓	✓
Rerange	✓	✓

#### Programmable output linearization function:

Output signal can be characterized with "14 points linear approximation function" from HHC<sup>(1)</sup>.

## Performance specifications for linear output

Reference conditions, silicone oil fill, 316SS isolating diaphragms, 4 to 20mA analog output in linear mode.

**Accuracy rating:** (including linearity, hysteresis, and repeatability)

For spans greater than 1/10 of URL:  $\pm 0.15\%$  of span

For spans below 1/10 of URL:

$$\pm \left( 0.1 + 0.05 \frac{0.1 \times \text{URL}}{\text{Span}} \right) \% \text{ of span}$$

**Stability:**  $\pm 0.15\%$  of upper range limit (URL) for 6 month.

**Temperature effect:**

Effects per 28°C change between the limits of - 40°C and +85°C

Zero shift	Total effect
$\pm \left( 0.1 + 0.075 \frac{\text{URL}}{\text{Span}} \right) \%$	$\pm \left( 0.125 + 0.075 \frac{\text{URL}}{\text{Span}} \right) \%$

**Static pressure effect:**

Zero shift (% of URL) :  $\pm 0.15\%$  /10MPa {100bar}

**Overrange effect:**

Range code (6th digit in Code symbols)	Zero shift (% of URL)
"3"	1 % URL / 16MPa
"5"	0.6 % URL / 16MPa

**Supply voltage effect:**

Less than 0.005% of calibrated span per 1V

**RFI effect:**

Less than 0.2% of URL for the frequencies of 20 to 1000MHz and field strength 30 V/m when electronics covers on.

(Classification: 2-abc: 0.2% span per SAMA PMC 33.1)

**Step response:** (without electrical damping)

Range code (6th digit in Code symbols)	Time constant*)	Dead time*)
"3"	0.3 s	0.2 s
"5"	0.2 s	

\*) Faster response is available as option (maximum update rate: 25 times per second).

**Mounting position effect:**

Zero shift, less than 0.12kPa {1.2m bar} for a 10° tilt in any plane.

No effect on span.

This error can be corrected by adjusting Zero.

**Dielectric strength:**

500V AC, 50/60Hz 1 min., between circuit and earth.

**Insulation resistance:**

More than 100MΩ at 500V DC.

**Turn-on time:**

4 sec.

**Internal resistance for external field indicator:**

12Ω or less

**Low flow cut-off:** In the case of square root output mode, customer configurable for any point between 0 to 20% of output.

## Physical specifications

**Electrical connections:**

G1/2, 1/2-14 NPT, Pg13.5, or M20 × 1.5 conduit, as specified.

1-port (standard) or 2-port with each conduit, as specified.

**Process connections:**

1/4-18 NPT or Rc1/4 on 54mm centers, as specified.

Meets DIN 19213.

**Process-wetted parts material:**

Material code (7th digit in Code symbols)	Process cover	Diaphragm	Wetted sensor body	Vent/drain
C	316 stainless steel(*1)	316L stainless steel(*2)	316 stainless steel	316 stainless steel

Notes: \* (1) SCS14 per JIS G 5121

(2) The diaphragm face is coated with gold and ceramic.

Remark: Sensor O-rings: Viton O-ring and teflon gasket selectable.

**Non-wetted parts material:**

Electronics housing: Low copper die-cast aluminum alloy finished with epoxy/polyurethane double coating (standard), or 316 stainless steel (SCS14 per JIS G5121), as specified.

Bolts and nuts: Cr-Mo alloy (standard), 304 stainless steel, or 630 stainless steel. Static pressure rating for code "3" with 304 stainless steel bolts is degraded to 10MPa.

Fill fluid: Silicone oil (standard) or fluorinated oil

Mounting bracket: 304 stainless steel, as specified

**Environmental protection:**

IEC IP67 and NEMA 6/6P

**Mounting:**

On 60.5mm(JIS 50A) pipe using mounting bracket, direct wall mounting, or direct process mounting.

**Mass{weight}:**

Transmitter approximately 4.4kg without options.

Add; 0.5kg for mounting bracket

0.8kg for indicator option

4.5kg for stainless steel housing option

## Optional features

- Indicator:** A plug-in analog indicator (1.5% accuracy) can be housed in the electronics compartment or in the terminal box of the housing.  
An optional 5-digit LCD meter with engineering unit is also available.
- Local adjustment unit with LCD display:** An optional 5-digit LCD meter with Zero/ Span adjustment function, loop-check function and damping adjustment function, is available.
- Arrester:** A built-in arrester protects the electronics from lightning surges.  
Lightning surge immunity : 4kV (1.2 x 50μs)
- Oxygen service:** Special cleaning procedures are followed throughout the process to maintain all process wetted parts oil-free.  
The fill fluid is fluorinated oil.
- Chlorine service:** The fill fluid is fluorinated oil.
- Degreasing:** Process-wetted parts are cleaned, but the fill fluid is standard silicone oil. Not for use on oxygen or chlorine measurement.
- NACE specification:** Metallic materials for all pressure boundary parts comply with NACE MR-01-75. ASTM B7M or L7M bolts and 2HM nuts (Class II) are available.  
Static pressure rating for code "3" (16 MPa) is degraded to 10MPa.
- Vacuum service:** Special silicone oil and filling procedure are applied.  
See Fig. 1.
- Optional tag plate:** An extra stainless steel tag with customer tag data is wired to the transmitter.
- Coating of cell:** Cell's surface is finished with epoxy/polyurethane double coating. Specify if environment is extremely corrosive.

## ACCESSORIES

- Oval flanges:** (Model FFP, refer to Data Sheet No. EDS6-10)  
Converts process connection to 1/2-14 NPT or to Rc1/2; in carbon steel or in 316 stainless steel.
- Equalizing valves:** (Model FFN, refer to Data Sheet No. EDS6-10)  
Available in CS or in 316 stainless steel and in pressure rating 16MPa or 42MPa.
- Hand-held communicator:** (Model FXW, refer to Data Sheet No. EDS 8-47)
- Z/S board:** Parts No.=ZZPFCX4-A070  
When Z/S board is mounted on the FCX-AII amplifier unit, external adjustment screw will be available for zero and span adjustment.

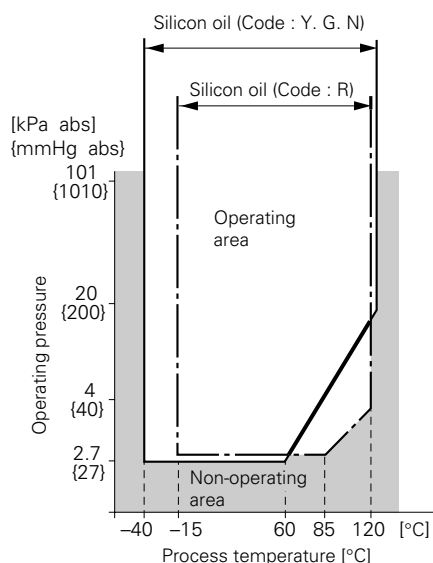


Fig. 1 Relation between process temperature and operating pressure

# CODE SYMBOLS

Digit	Description				Note	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	Digit No. of code	
4	<Connections>					F	K	C					4	-								
	Process connection	Oval flange screw	Conduit connection																			
	Rc1/4	7/16-20UNF	G1/2 (×1)	Combination with 12th digit code "C, E, P, Q" are not available.						A												
	1/4-18NPT	7/16-20UNF	1/2-14NPT (×1)								B											
	1/4-18NPT	M10	Pg13.5 (×1)								C											
	1/4-18NPT	M10	M20×1.5 (×1)								D											
	1/4-18NPT	7/16-20UNF	Pg13.5 (×1)								E											
	Rc1/4	7/16-20UNF	G1/2 (×2)							S												
	1/4-18NPT	7/16-20UNF	1/2-14NPT (×2)							T												
	1/4-18NPT	M10	Pg13.5 (×2)							V												
	1/4-18NPT	M10	M20×1.5 (×2)							W												
	1/4-18NPT	7/16-20UNF	Pg13.5 (×2)							X												
5, 6, 7	<Span and materials>																					
	Static pressure [MPa] {bar}	Span limit (*1) [kPa] (mbar)	Process cover	Diaphragm	Wated cell body																	
	-0.1 to 16 (-1 to +160)	3.2...32 (32...320)	316 stainless steel	316Lstainless steel (*1)	316 stainless steel	Note 1								33C								
		13...130 (130...1300)				Note 1								35C								
9	<Indicator and arrester>																					
	<u>Indicator</u>		<u>Arrester</u>																			
	None		None		Z/S board attached. Approval pending for 10th digit code "G, H, J, K, P"	Note 2																
	Analog, 0 to 100% linear scale		None																			
	Analog, 0 to 100% sq. root scale		None (*2)																			
	Analog, custom scale		None																			
	Analog, double scale(linear and sq.root)		None																			
	None		Yes		Z/S board attached. Approval pending for 10th digit code "G, H, J, K, P"	Note 2																
	Analog, 0 to 100% linear scale		Yes																			
	Analog, 0 to 100% sq. root scale		Yes (*2)																			
	Analog, custom scale		Yes																			
	Analog, double scale(linear and sq.root)		Yes																			
	Digital, 0 to 100%		None		Z/S board attached. Approval pending for 10th digit code "G, H, J, K, P"	Note 4																
	Digital, custom scale		None(*4)																			
	Digital, 0 to 100% square root		None																			
	Digital, 0 to 100%		Yes																			
	Digital, custom scale		Yes (*4)				Note 4															
	Digital, 0 to 100% square root		Yes		Z/S board attached. Approval pending for 10th digit code "G, H, J, K, P"																	
	Digital, 0 to 100%		None																			
	(Local adjustment unit with LCD display)		None																			
	Digital, custom scale		None																			
	(Local adjustment unit with LCD display)		None																			
	Digital, 0 to 100%		Yes		Z/S board attached. Approval pending for 10th digit code "D, E, G, H, J, K, P"																	
	(Local adjustment unit with LCD display)		Yes																			
	Digital, custom scale		Yes																			
	(Local adjustment unit with LCD display)		Yes																			
10	<Approvals for hazardous locations>																					
	None (for ordinary locations)																					
	TIIS, Flameproof (Conduit seal)		(Available for 4th digit code "A", "S")																			
	TIIS, Flameproof (Cable gland seal)		(Available for 4th digit code "A", "S")																			
	FM, Flameproof (or explosionproof)		(Available for 4th digit code "B", "T")																			
	CSA, Flameproof (or explosionproof)		(Available for 4th digit code "B", "T")																			
	ATEX, Flameproof																					
	TIIS, Intrinsic safety (Approval pending)																					
	FM, Intrinsic safety and Nonincendive																					
	CSA, Intrinsic safety and Nonincendive																					
	ATEX, Intrinsic safety																					
	ATEX, Type n																					
11	<Vent/drain and mounting bracket>																					
	Vent/drain	Mounting bracket																				

Note 1: (\*1) The diaphragm face is coated with gold and ceramic.

Note 2: (\*2) In case of square root output mode, square root scale is not available.

Note 4: (\*4) Specified the output mode linear or sq. root. Unless specified the output mode is linear. In case of 9th digit code "P", "S", specified the output indication. Unless specified, the indication is output mode.

Digit	Description			Note	1 2 3 4 5 6 7 8 9 10 11 12 13 14 15															Digit No. of code																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																								
12	<u>&lt;Options&gt;</u> <u>Extra tag plate</u> <u>Stainless steel elec. housing</u> <u>Coating of cell</u> None                      None                      None Yes                      None                      None None                      Yes                      None Yes } (*5)                      Yes                      None ----- None                      None                      Yes Yes                      None                      Yes None                      Yes                      Yes Yes                      Yes                      Yes			Note 5	F	K	C						4	-																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																														</

Note 3: (\*3) Static pressure should be  $-0.1$  to  $+10\text{MPa}$ { $-1$  to  $100\text{bar}$ }

Note 5: (\*5) Customer tag number can be engraved on standard stainless steel name plate. If extra tag plate is required, select "Yes".

Note 6: (\*6) In case of tropical use, select stainless bolts and nuts.

Note 7: (\*7) Not available for 15th digit code "A, B"



## ORDERING INFORMATION

When ordering this instrument, specify:

1. CODE SYMBOLS
2. Measuring range
3. Output orientation (burnout direction) when abnormality is occurred in the transmitter.  
Hold / Overscale (21.6mA) / Underscale (3.2mA)  
Unless otherwise specified, output hold function is supplied.
4. Output mode (linear or square root output)  
Unless otherwise specified, output mode is linear.
5. Indication method (indicated value and unit) in case of the actual scale (code D, H, P, S on 9th digit).
6. Tag No. (up to 26 alphanumerical characters), if required.

The product conforms to the requirements of the Electromagnetic compatibility Directive 94/9/EC as detailed within the technical construction file number TN513035.

The applicable standards used to demonstrate compliance are :

**EMI (Emission) EN61326 : 1997**  
**Class A (standard for Industrial Location)**

Frequency range MHz	Limits	Reference standard
30 to 230	40dB ( $\mu\text{V/m}$ ) quasi peak, measured at 10m distance	CISPR16-1 and CISPR16-2
230 to 1000	47dB ( $\mu\text{V/m}$ ) quasi peak, measured at 10m distance	

**EMI (Immunity) EN61326: 1997**  
**Annex A (standard for Industrial Location)**

Phenomenon	Test value	Basic standard	Performance criteria
Electrostatic discharge	4kV (Contact) 8kV (Air)	IEC61000-4-2	B
Electromagnetic field	80 to 1000MHz 10V/m 80%AM (1kHz)	IEC61000-4-3	A
Rated power frequency magnetic field	30A/m 50Hz	IEC61000-4-8	A
Burst	2kV 5kHz	IEC61000-4-4	B
Surge	1.2 $\mu\text{s}$ /50 $\mu\text{s}$ 1kV (Line to line) 2kV (Line to ground)	IEC61000-4-5	B
Conducted RF	0.15 to 80MHz 3V 80%AM (1kHz)	IEC61000-4-6	A

**Note) Definition of performance criteria**

**A: During testing, normal performance within the specification limits.**

**B: During testing, temporary degradation, or loss of function or performance which is self-recovering.**

## Fuji Electric Co.,Ltd.

### Head office

11-2 Osaki 1-chome, Shinagawa-ku, Tokyo, 141-0032 Japan  
<http://www.fujielectric.co.jp>

## Fuji Electric Instruments Co.,Ltd.

### Sales Div.

#### International Sales Dept.

No.1, Fuji-machi, Hino-city, Tokyo, 191-8502 Japan  
Phone: 81-42-585-6201, 6202  
Fax: 81-42-585-6187  
<http://www.fic-net.co.jp>